



Commercial & Residential Marketing News

M-205-2004

October 14, 2004


To: All Distributor Principals, Branch Managers, Distributor Sales Managers, Regional Vice Presidents, and Regional Sales Managers

Subject: UPG Serial Number Nomenclature

To support our new operating system, the serial number nomenclature has changed.

- Applies to all Commercial and Residential product built by UPG
- Effective 10/6/2004
- Product built after 10/6/2004 will have the new serial number nomenclature shown below

UPG Serial Number Nomenclature

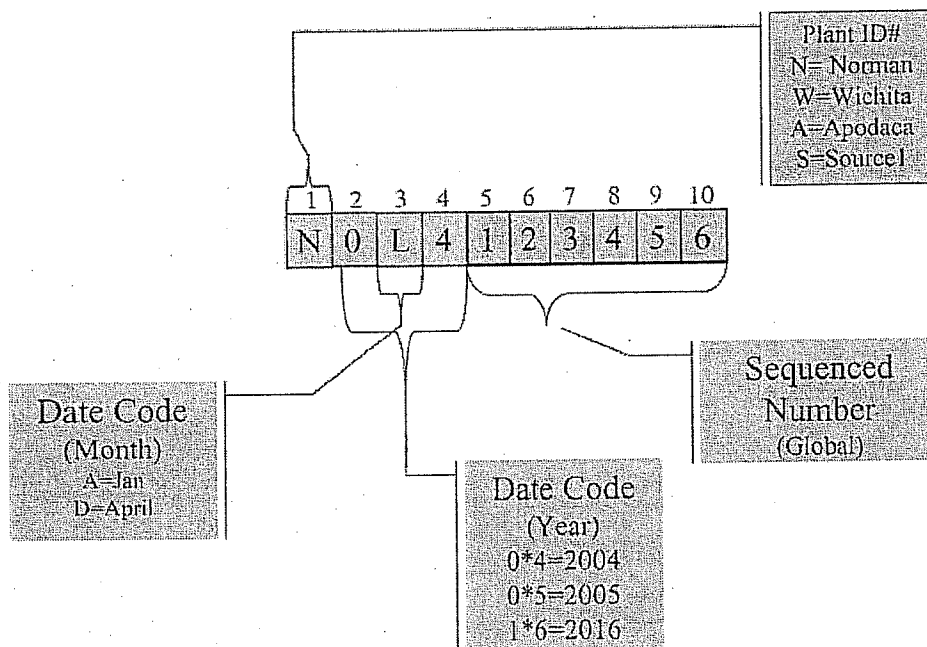

Please feel free to contact us at 405-419-6541 or 405-419-6546 respectively, with questions.


Regards and Good Selling,

Mickey Smith
Marketing Manager,
Residential Products

Regards and Good Selling,

Walt Jacob
Marketing Manager,
Commercial Products

YORK SERIAL NUMBER INFORMATION
FROM 1960 TO 2005

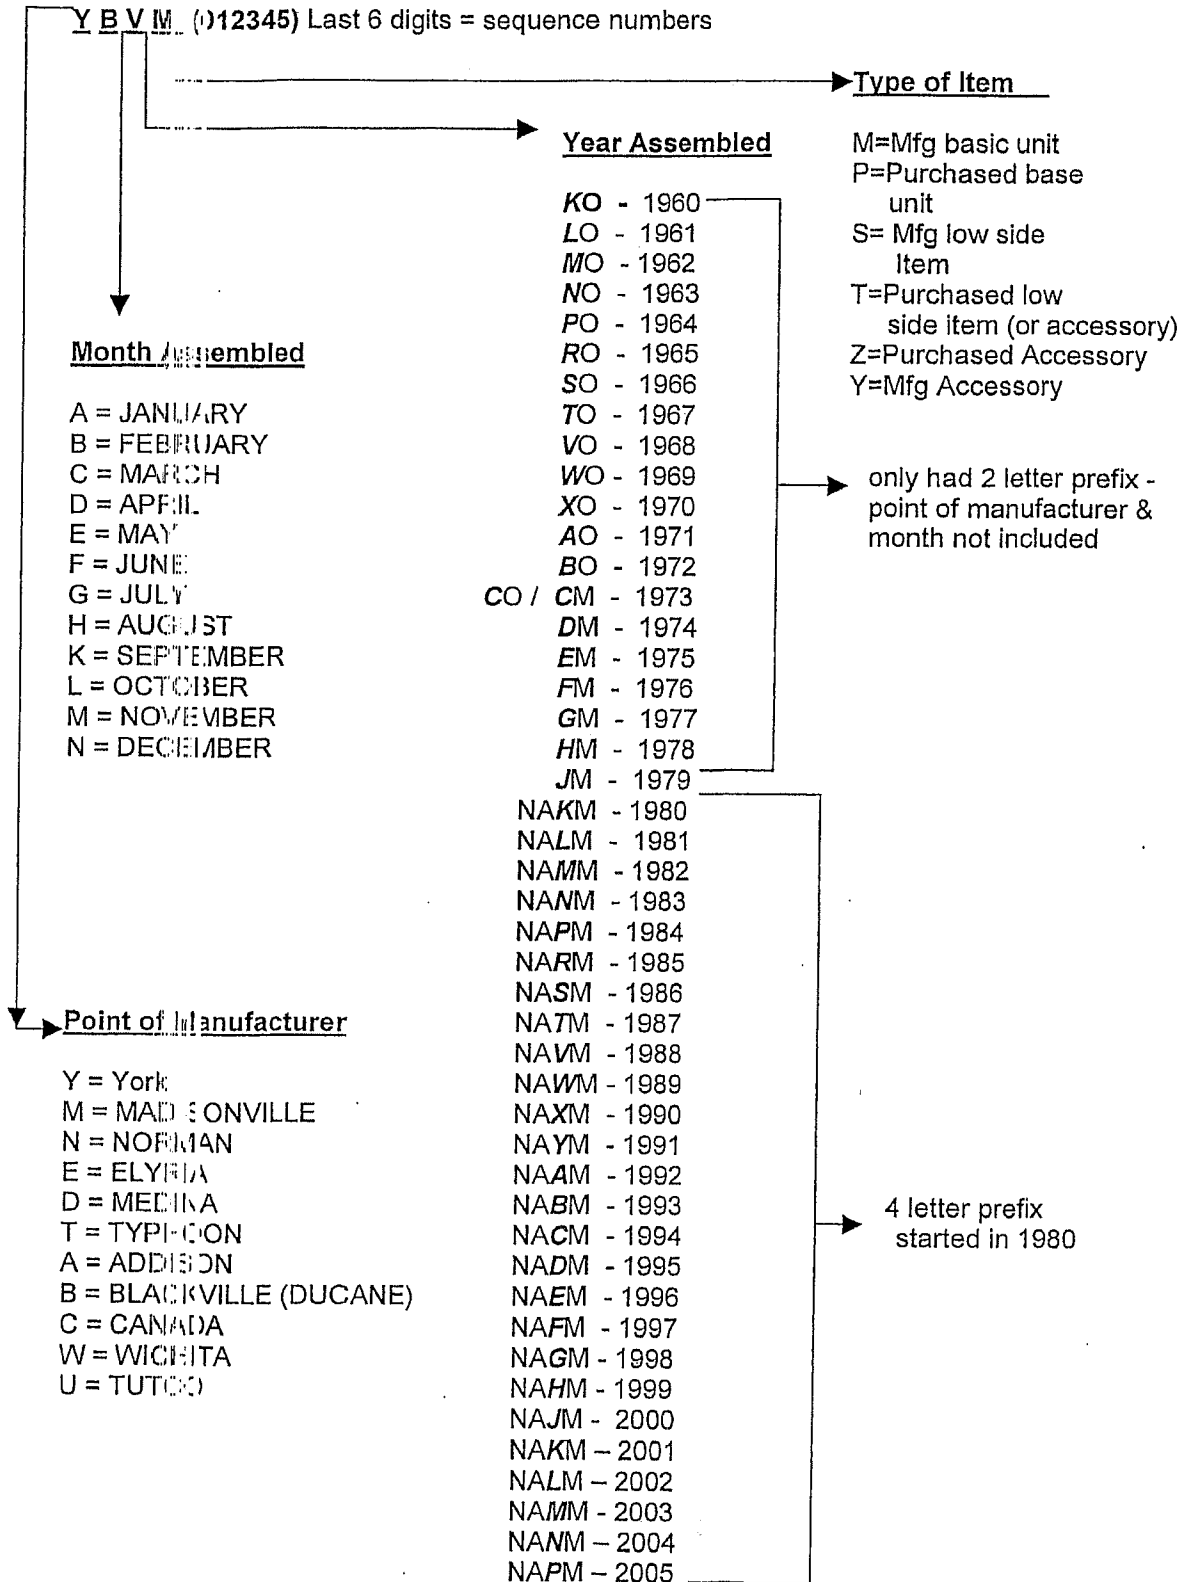


FACILITY INSTALLED HEAT A = Not Applicable (No Heat) E = Electric F = Fuel Oil G = Natural Gas L = Low Nox Natural Gas N = Natural Gas P = Propane Gas	OPTIONAL IDENTIFIER Solid Systems A = Not Applicable C = Cooling Only A = Quick Connect F = Full Cased H = Horiz. Drain Pan N = No Horiz. Drain Pan S = Sweat Connect U = Half Cased Ground Source H.P. C = Counterflow H = Horizontal S = Split Condenser V = Vertical	VOLTAGE CODE 50 HZ 60 HZ 01 = 115V-60 50 = 380/415-3-50 06 = 208/230-1-50 61 = 200-3-50 10 = 230-1-50 62 = 208-3-50 17 = 208-3-50 63 = 380-3-50 18 = 208-1-50 64 = 400-3-50 25 = 208-3-50 65 = 415-3-50 26 = 230-3-50 73 = 115-1-50 28 = 230-3-50 78 = 230-1-50 33 = 208/230/460-3-50 40 = 380-3-50 45 = 440/480-3-50 46 = 460-3-50 51 = 460-1-50 58 = 575-3-50	CABINET WIDTH Indoor Code 14 = 14" 17 = 17.5" 21 = 21" 24 = 24.5" OF = Outdoor Furnace															
OR																		
NOM. COOLING CAPACITY Exclud. Evaporators / Air Handlers (120 x 1000 = 120,000 Btu/h) MBH 1 2 0																		
NOM. HEATING CAPACITY Oil and Gas - MBH (200 x 1000 = 200,000 Btu/h) (Output) 2 0 0 Electric - KW 0 4 0 (= 40 KW)																		
OR																		
OPTIONAL IDENTIFIER Evaporators / Air Handlers D 0 8 CFM (8 x 100 = 800 cfm) Drive B = Belt D = Direct OR Furnace Cab. Width A = 14.5" C = 21.5" D = 24.5" X = non-standard																		
FACTORY INSTALLED OPTION CODE Typical Option Number and Letter Code Legend <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>OPTION NUMBER</th> <th>DESCRIPTION</th> <th>LETTER CODE</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>Single Input Economizer</td> <td>EC</td> </tr> <tr> <td>6</td> <td>Alternate Motor/Drive</td> <td>JS</td> </tr> <tr> <td>8</td> <td>Dual Input Economizer</td> <td>DK</td> </tr> <tr> <td></td> <td>Multifunctional Enhancer</td> <td></td> </tr> </tbody> </table>				OPTION NUMBER	DESCRIPTION	LETTER CODE	1	Single Input Economizer	EC	6	Alternate Motor/Drive	JS	8	Dual Input Economizer	DK		Multifunctional Enhancer	
OPTION NUMBER	DESCRIPTION	LETTER CODE																
1	Single Input Economizer	EC																
6	Alternate Motor/Drive	JS																
8	Dual Input Economizer	DK																
	Multifunctional Enhancer																	
BASIC UNITS - DATA PLATE SERIAL NUMBER INFORMATION XXXXXX999999 6-digit sequence number																		
MONTH ASSEMBLED A = January G = July B = February H = August C = March K = September D = April L = October E = May M = November F = June N = December																		
YEAR ASSEMBLED X = 1990 Y = 1991 A = 1992 B = 1993 C = 1994 D = 1995 E = 1996 F = 1997																		
RESPONSIBLE PLANT E = Elvira N = Norman W = Wichita																		
TYPE OF ITEM M = Mig. Basic Unit P = Purchased Basic Unit S = Mig. Low Side Item T = Purchased Low Side Item Y = Mig. Accessory Z = Purchased Accessory																		

- 1 The Product Generation is upgraded when changes affect capacity, efficiency, air flow or accessory
- 2 The Product line/line is used to distinguish product families. Refer to product Price Page for specific data
- 3 The Option Code is used to identify the option number(s) required. Refer to product Price Page for specific data
- 4 Style is upgraded to reflect component changes (not affecting capacity, efficiency, airflow or accessory)
- 5 Ventilator nomenclature does not follow the standard format. Refer to product Price Page for specific data



Source 1 Serial Number System

York, Luxaire and Fraser Johnston

Coleman

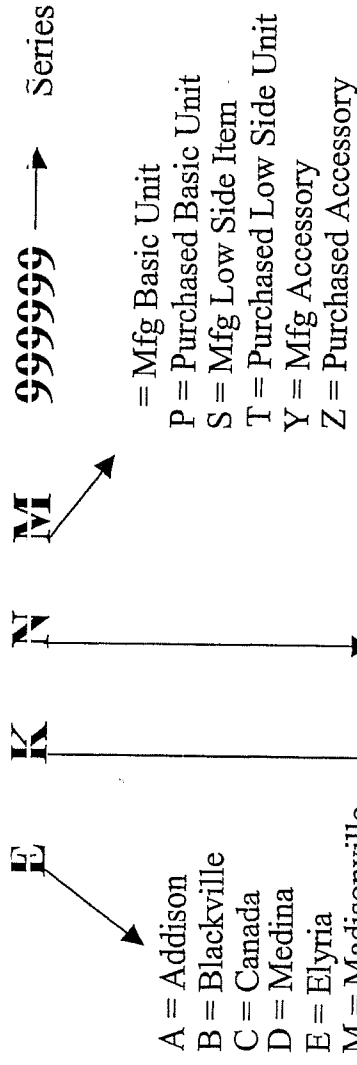

For serial numbers prior to April 1992

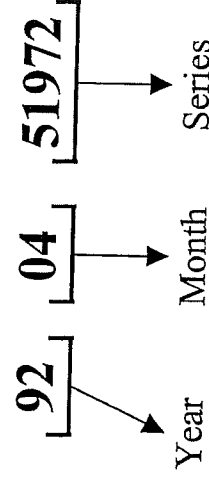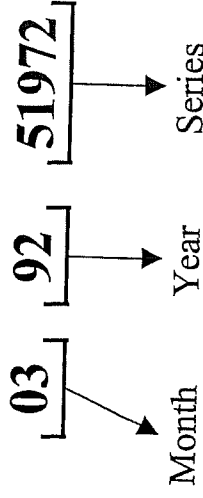

For serial numbers beginning April 1992

NOTE: Serial numbers prior to 1980 were 2 alpha 6 numeric. In order to use the in AS400, on the serial number line press the space bar 2 ties then enter the 8 character serial number. Fraser Johnston and Luxaire were purchased by York in 1980.